


When the wiring and piping from the cable ground are used: **For 60 mm or more**



* If the cabling length is 70 mm or more, secure a wider cabling space to the end-effector side so that the wiring and piping are not suddenly bent. (Refer to the figure below.)

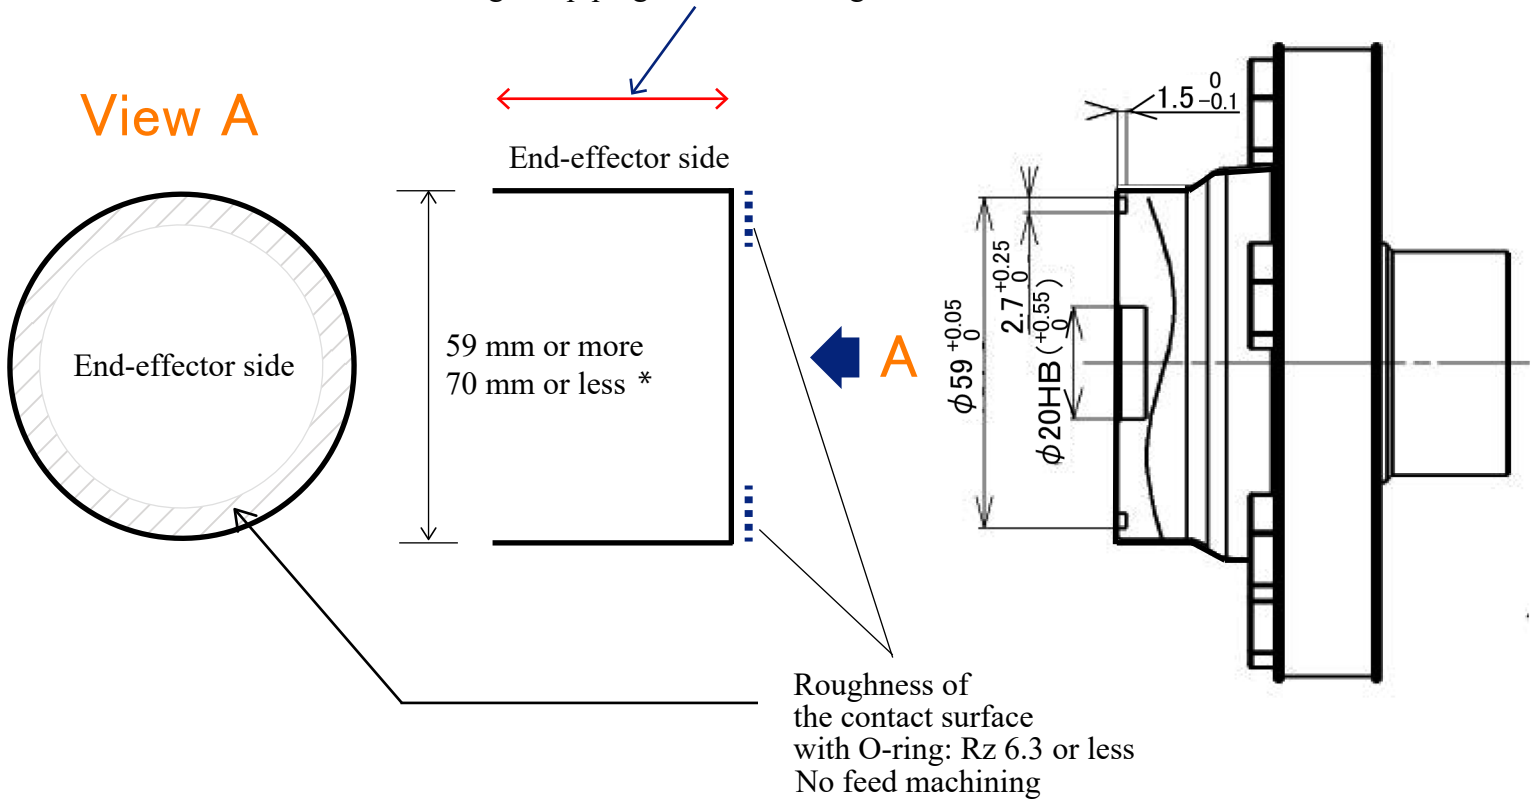